

OWNER'S MANUAL

SINGLE PACKAGE HEAT PUMP UNITS

TABLE OF CONTENTS

| | |
|--|----------|
| GENERAL INFORMATION | 2 |
| HOW YOUR HEAT PUMP WORKS | 2 |
| SYSTEM OPERATION | 2 |
| HEATING CYCLE | 2 |
| COOLING CYCLE | 2 |
| PROPER CARE OF YOUR SYSTEM | 3 |
| LUBRICATION | 3 |
| FILTER CARE | 3 |
| AIR FILTERS | 3 |
| REGISTERS | 3 |
| CONDENSER COIL | 3 |
| BLOWER ASSEMBLY | 3 |
| CHARACTERISTICS OF HEAT PUMPS . | 3 |
| A CONSTANT HEAT | 3 |
| WATER RUN - OFF | 3 |
| OUTDOOR COIL DEFROSTING | 3 |
| FIGURES | |
| FILTER ACCESS | 4 |
| TABLES | |
| TROUBLE SHOOTING GUIDE | 5 |
| REPLACEMENT PARTS | 5 |



Tested in accordance with:



SAVE THIS MANUAL

Congratulations...

on your purchase of our heat pump. This energy efficient unit has been precision designed, manufactured of high-quality materials and has passed many rigorous inspections and tests to ensure years of satisfactory performance. Please read this booklet thoroughly. It will help you understand your heat pump and will tell you how to operate it efficiently and how to obtain the greatest measure of comfort at the lowest operating expense. We appreciate your interest in our products and your decision to purchase our heat pump. Enjoy your comfort.

This heat pump has been specially developed and built as a heat pump to meet dual needs of heating and cooling. That's why you can rely on efficient, trouble-free operation.

Your system is fully automatic. Set the thermostat and forget it. And it's automatically protected against damage by voltage fluctuations or excessive heating or cooling demands.

GENERAL INFORMATION

HOW YOUR HEAT PUMP WORKS

If your hand is wet and you blow on it, it feels cool because some of the moisture is evaporating and becoming a vapor. This process requires heat. The heat is being taken from your hand, as your hand feels cool.

That's what happens with a heat pump. During the cooling cycle, your system will remove heat and humidity from your structure and will transfer this heat to the outdoor air.

During the heating cycle, your system will remove heat and humidity from the outdoor air* and will transfer this heat to your structure. Remember that your heat pump doesn't generate much heat, it merely transfers it from one place to another.

*This is possible because even 0°F outdoor air contains a great deal of heat.

SYSTEM OPERATION

Your thermostat puts full control of the comfort level in your structure at your fingertips.

Set your thermostat for heating or cooling. Find the temperature that is most comfortable for you, and then leave your thermostat alone. Manually moving the thermostat up or down to extreme settings will not speed up temperature changes. Avoid moving the thermostat up during heating - particularly where a demand type electric meter is installed. This will increase your operating cost substantially.

CAUTION

The Main power to the system must be kept "On" at all times to prevent damage to the outdoor unit compressor. If necessary, the thermostat control switch should be used to turn the system "Off". Should the main power be disconnected or interrupted for 8 hours or longer, DO NOT attempt to start the system for 8 hours after the power has been restored to the outdoor unit. If heat is needed during this 8 hour period, use emergency heat.

HEATING CYCLE

With the thermostat in the heating position, and outdoor temperature in the range or 20 - 30° or below, the outdoor unit will generally run 100% of time.

When the outdoor air is cool and moist, frost may form on the surface of your outdoor coil. When this frost builds to a certain point, your system will switch to a defrost cycle. Although you may feel cooler air coming from your registers, DO NOT adjust your thermostat. This frost will melt quickly, and your system will return to normal operation automatically.

COOLING CYCLE

Switch your thermostat to cool. Select a comfortable thermostat temperature setting, typically between 75 and 80 degrees. Comfort sensations vary with individuals. The lower the indoor temperature desired, the greater the number of hours your unit must operate.

PROPER CARE OF YOUR SYSTEM

CAUTION

Prior to any of the following maintenance procedures, shut off all power to the unit

In order to insure long and trouble free service from your system, we recommend periodic inspection, cleaning, lubrication and adjustment by your installing Dealer/Contractor. Be sure to ask about this service.

For those buildings with in-house maintenance, please follow the instructions listed below to care for your system.

LUBRICATION

Both the indoor blower motor and outdoor fan motor are permanently lubricated and require no maintenance.

FILTER CARE

Filters must always be used and must be kept clean. When filters become dirt laden, insufficient air will be delivered by the blower, decreasing your units efficiency and increasing operating costs and wear-and-tear on the unit and controls.

AIR FILTERS

All units contain 2" filters. Filters can also be installed in the building at a suitable return air location if an economizer or outside air accessory is not used. They should be inspected once a month and thoroughly cleaned or replaced if it appears they are beginning to accumulate excessive dirt.

NOTE:

Filters must be installed with Air Flow arrows pointing inward -- toward the indoor coil.

Slide filters all the way into the filter racks provided. When more than one filter in a filter rack is required, they must butt each other when sliding into position. Replace the filter access panel. See Fig. 1.

REGISTERS

Supply and return air registers must be open when the unit is in operation. Furniture must not block airflow in or out of the registers.

CONDENSER COIL

An annual check and cleaning of the outdoor coil should be done. Clean any debris and dirt from the outside coil face with a brush being careful not to damage the fins. If extremely dirty, a hose can be used to wash the coil from the inside out while brushing a soapy solution on the outside.

BLOWER ASSEMBLY

Even with good filters properly in place, blower wheels and motors will become dust laden after long months of operation. The entire blower assembly should be inspected annually. If the motor and wheel are heavily coated with dust, they can be brushed and cleaned with a vacuum cleaner.

CHARACTERISTICS OF HEAT PUMPS

A CONSTANT HEAT

Heat pumps have a noticeably cooler supply air temperature than furnaces. The common practice of over-sizing furnaces contributes to an "off-and-on-again" operation with short blasts of hot supply air. The heat pump system is sized more closely to the heating needs of your home. Heat is supplied at a lower temperature over a longer period of time to provide a more constant heat, and it may give you the impression that your system "never stops running".

WATER RUN - OFF

During the heating cycle, you may notice water running off the outdoor coil. Moisture from the air is condensed on the outside surface of the coil where it gathers and runs off. No need for alarm, your unit has not sprung a leak!

OUTDOOR COIL DEFROSTING

At certain outdoor conditions (low temperature, high humidity), frost may build up on the coil of the outdoor unit. In order to maintain heating efficiency, the system will automatically defrost itself.

Water vapor rising from the outdoor unit is normal and is an indication of proper operation. The vapor cloud will only last for a few minutes. When the defrost cycle is completed, the system will automatically switch back to heating. Electric heat is automatically energized to maintain comfort during defrost.

BEFORE CALLING A SERVICE PERSON

- Check thermostat setting and insure thermostat is calling for heat or cooling. Check thermostat for lint, etc.
- Check fuses or circuit breakers
- Check filters for excessive dust accumulation

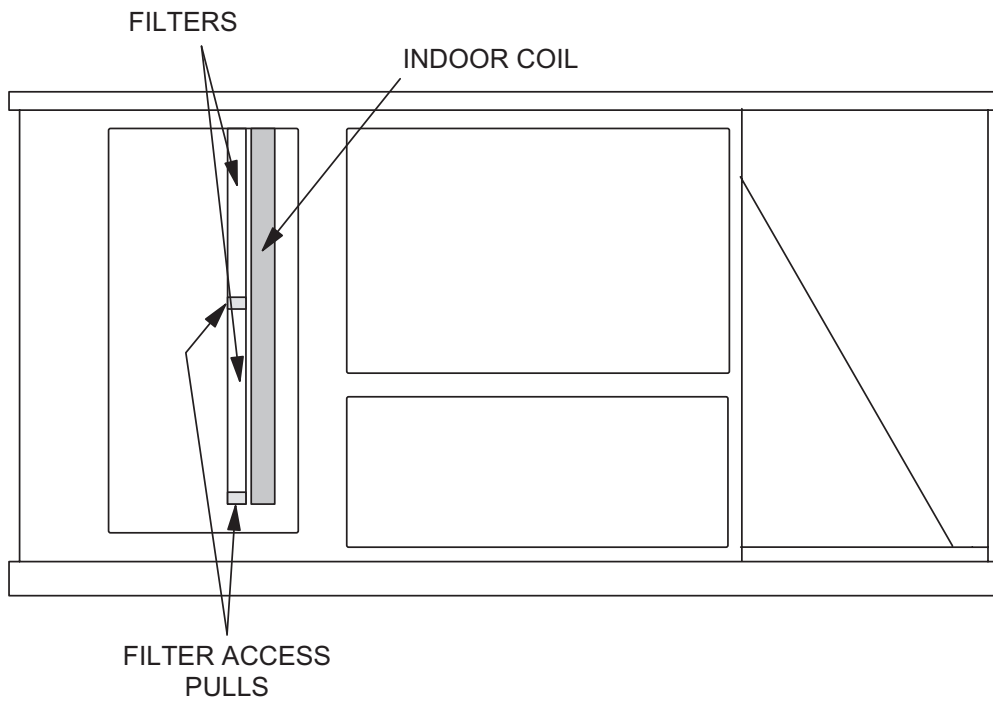


FIGURE 1 : FILTER ACCESS

TABLE 1: TROUBLE SHOOTING GUIDE

| PROBLEM | CORRECTION |
|---|--|
| NO HEAT | Check thermostat for proper setting Check circuit breaker and fuses. Check filters. Call qualified service man. |
| NOT ENOUGH HEAT - OUTDOOR UNIT NOT RUNNING | Check thermostat for proper setting. Check circuit breaker and fuses. Switch thermostat to Emergency Heat position. Call qualified service man. |
| NO COOLING | Check thermostat for proper setting. Check circuit breaker and fuses. Check filters. Call qualified service man. |
| ELECTRICAL POWER INTERRUPTION (ice, snow, or wind storms) | Procedure Heating Season: 1. Switch thermostat to Emergency Heat.* 2. Leave on Emergency Heat for at least 12 hours after electrical power is re-established. 3. Switch thermostat back to Heating or Auto. Procedure Cooling Season: 1. Switch thermostat to Off position. 2. Do not switch to Cooling or Auto unit electrical power has been re-established for 4 hours. |

*There will be no heat available until power is re-established

REPLACEMENT PARTS

Single Package Heat Pump (6.5 Thru 12.5 Ton)

Renewal Parts Form No.

035-18512-000

Respective Model No.

BA*****1

Single Package Heat Pump (6.5 Thru 12.5 Ton)

Renewal Parts Form No.

035-19235-000

Respective Model No.

BA*****2

Single Package Heat Pump (6.5 Thru 12.5 Ton)

Renewal Parts Form No.

035-19237-000

Respective Model No.

BA*****3

Single Package Heat Pump (6.5 Thru 12.5 Ton)

Renewal Parts Form No.

035-18511-000

Respective Model No.

BP*****1

Single Package Heat Pump (6.5 Thru 12.5 Ton)

Renewal Parts Form No.

035-19236-000

Respective Model No.

BP*****2

Single Package Heat Pump (6.5 Thru 12.5 Ton)

Renewal Parts Form No.

035-19238-000

Respective Model No.

BP*****3

OWNER please have your installer fill in the following information immediately after unit has been installed and properly operating.

Installed by _____

Installer's Address _____

Installation Date _____

Owner's Name _____

Owner's Address _____

Equipment installed at (address) _____

Model Number _____ Serial Number _____

Distributor from whom the equipment was purchased _____

The owner should keep this information in a place where it can be found if needed for warranty purposes.