

# SUBMITTAL DATA SHEET



**SPLIT-SYSTEM CONDENSING UNITS**  
**15 & 20 TONS**  
**MODELS: H\_HB180 & H\_HB240**

JOB NAME:		LOCATION:		
PURCHASER:		ORDER NO:		
ENGINEER:				
SUBMITTED TO:	FOR:	REF:	APPROVAL:	CONSTRUCTION:
SUBMITTED BY:		DATE:		
UNIT DESIGNATION:		SCHEDULE NO.	MODEL NO.	

**COOLING PERFORMANCE**

TOTAL CAPACITY----- MBH

OUTDOOR DESIGN TMP. ----- °F

SUCT. PRESS. AT SATURATION -- PSIG

SUCT. TEMP. AT SATURATION ----- °F

**ELECTRICAL DATA**

POWER SUPPLY----- / /

TOTAL UNIT AMPACITY ----- AMPS

POWER INPUT REQUIREMENT ----- KW

MAXIMUM FUSE SIZE ----- AMPS  
(DUAL ELEMENT)

**UNIT WEIGHT**

TOTAL OPERATING WEIGHT ----- LBS

**STANDARD FEATURES**

- Simplicity® Controls
- CSA listed to US and Canadian Standards
- Dual Hermetic Scroll Compressors with Capacity Reduction
- Propeller-Type Condenser Fans
- Inherently Protected Fan Motors with Ball Bearings
- Low Ambient to 45°F
- Anti-Cycle Protection
- Refrigerant-22 Holding Charge
- 24 Volt Temperature Control Circuit
- Crankcase Heaters
- Copper Tube/Aluminum Fin Coil
- Exterior Service Port Connections
- Base Rails with Forklift Slots
- High, Low Pressure Controls
- Backseating Suction and Liquid Line Service Valves
- Filter-Drier Supplied for Field Installation
- 1-Year Limited Parts Warranty on Complete Unit with an Additional 4-Year Warranty on the Compressor

**FIELD INSTALLED ACCESSORIES**

- 0° Low Ambient Control -----
- Decorative Coil Guard -----
- Phenolic Coating on Condenser Coil -----
- Pumpout -----

**MATCHING AIR SIDE EQUIPMENT**

Model No. ----- ( \_\_\_\_\_ )  
 Submittal Form No. ----- ( \_\_\_\_\_ )

**NOTES:**

---




---



---

Refer to Technical Guide for unit specifications.

## DIMENSIONS - INCHES

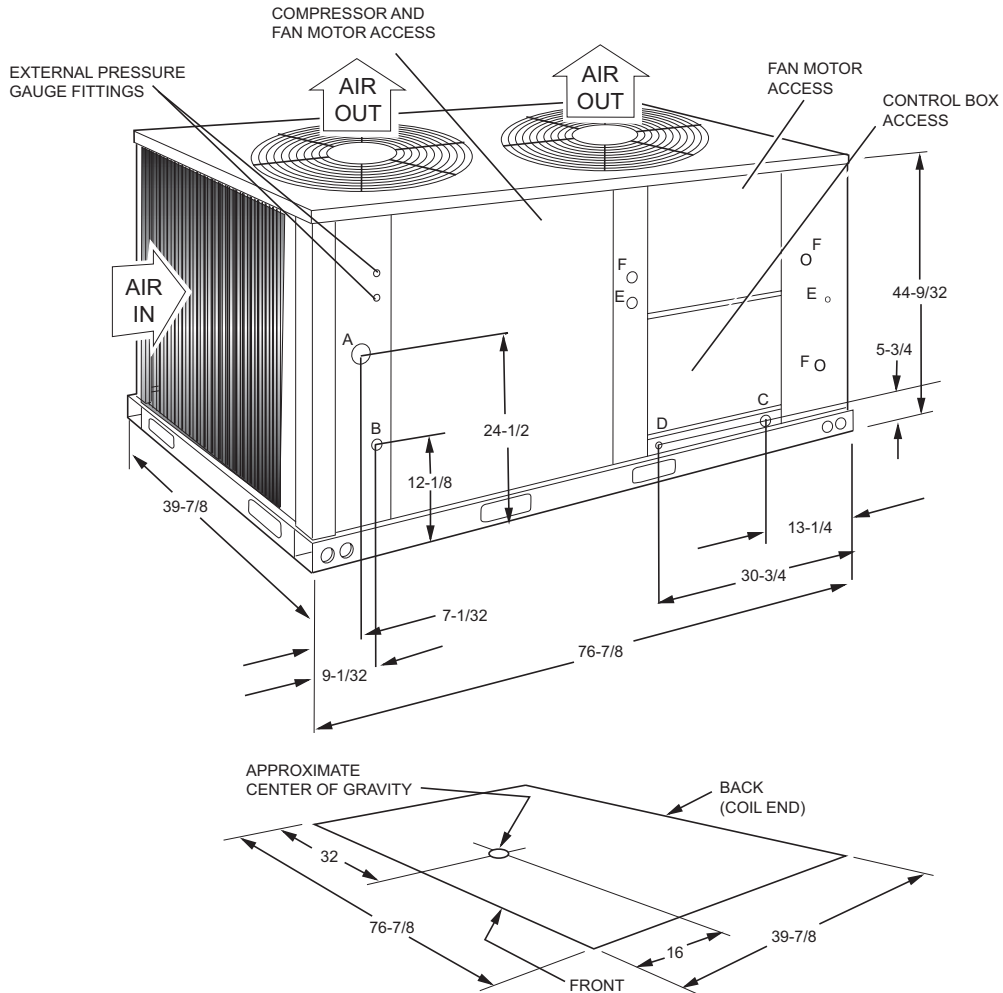

CONNECTION ENTRY		CONNECTION SIZE	
		15 TON	20 TON
SUCTION LINE	A	1-5/8 O.D.	2-1/8 O.D.
LIQUID LINE	B	5/8 O.D.	7/8 O.D.
POWER WIRING	C	2-1/8 KO	2-1/8 KO
CONTROL WIRING	D	7/8 KO	7/8 KO
ACCESSORY WIRING	E	7/8 KO	7/8 KO
ACCESSORY WIRING	F	1-3/8 KO	1-3/8 KO

### CLEARANCES

OVERHEAD (TOP) <sup>1</sup> .....	120"
FRONT (PIPING & ACCESS PANELS) .....	30"
LEFT SIDE .....	24"
RIGHT SIDE .....	24"
REAR .....	24"
BOTTOM <sup>2</sup> .....	0"

1. Units must be installed outdoors. Overhanging structures or shrubs should not obstruct condenser air discharge.
2. Adequate snow clearance must be provided if winter operation is expected.

Subject to change without notice. Printed in U.S.A.  
 Copyright © 2007 by Unitary Products Group. All rights reserved.

332730-CSD-A-0307  
 Supersedes: 550.23-SD3C (498)

Unitary  
 Products  
 Group

5005  
 York  
 Drive

Norman  
 OK  
 73069