


JOB NAME _____ LOCATION _____
 PURCHASER _____ ORDER NO. _____
 ENGINEER _____
 SUBMITTED TO _____ FOR: Reference Approval Construction
 SUBMITTED BY _____ DATE _____

UNIT DESIGNATION: Schedule No. _____ MODEL NO. _____

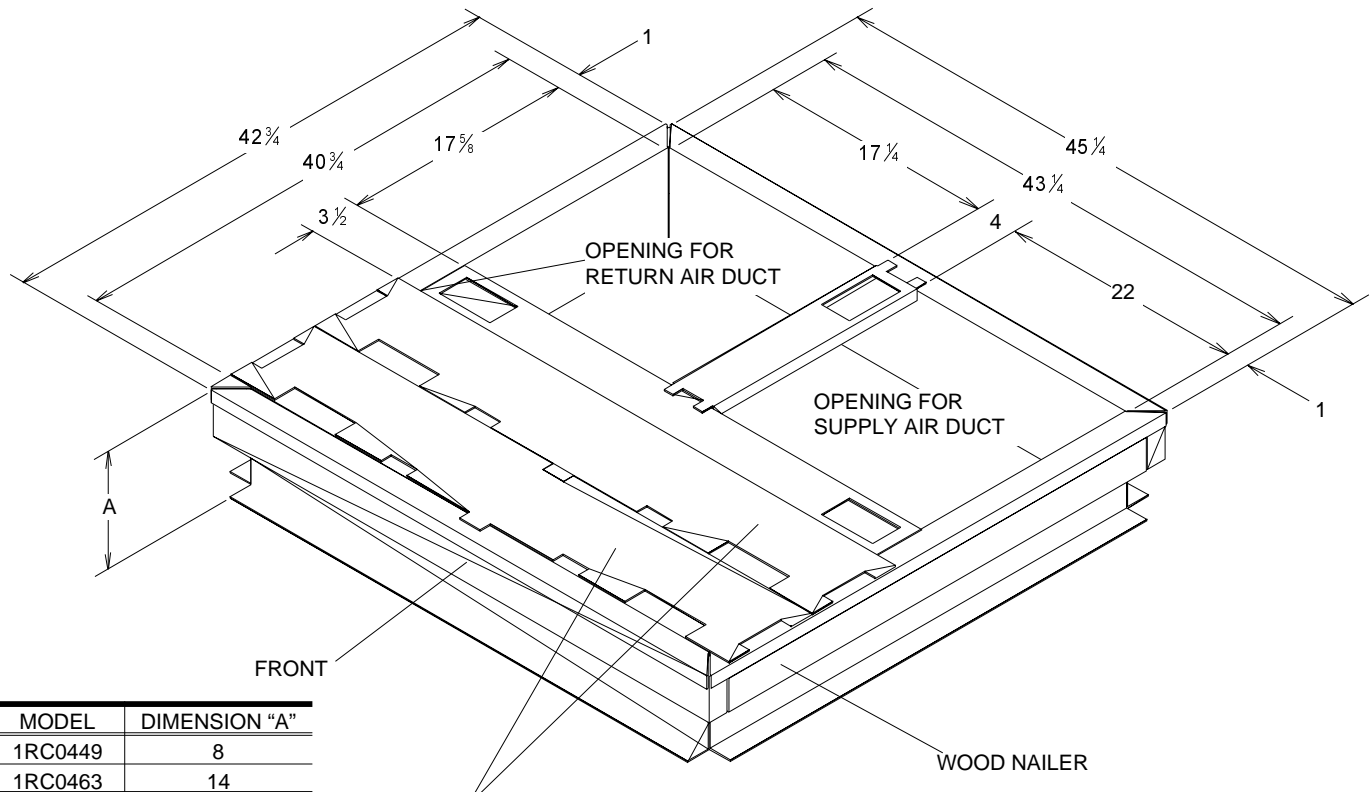

MODEL	DIMENSION "A"
1RC0449	8
1RC0463	14

RECOMMENDED DUCT SIZE	
SUPPLY AIR DUCT	17 1/8" x 21 1/2"
RETURN AIR DUCT	17 1/8" x 16 3/4"

NOTE:

1. Roof curb is built to NRCA standards.
2. Roof curb is constructed of 18 gauge G90 steel.
3. Unit duct supports are provided.
4. Full perimeter 1 x 4 wood nailer.
5. Curbs are shipped unassembled.
6. Corner hinge pins are used for assembly.

Roof opening; 43 1/8" long x 18 1/8" wide

Subject to change without notice. Printed in the U. S. A.

ROOF CURB
MODELS: 1RC0449 AND 1RC0463

FOR THE FOLLOWING UNITS;
 BUA, BUH, DPB, DPH, DYA, DYH

FORM 530.46-SD10C-0197

Supersedes: Nothing

